


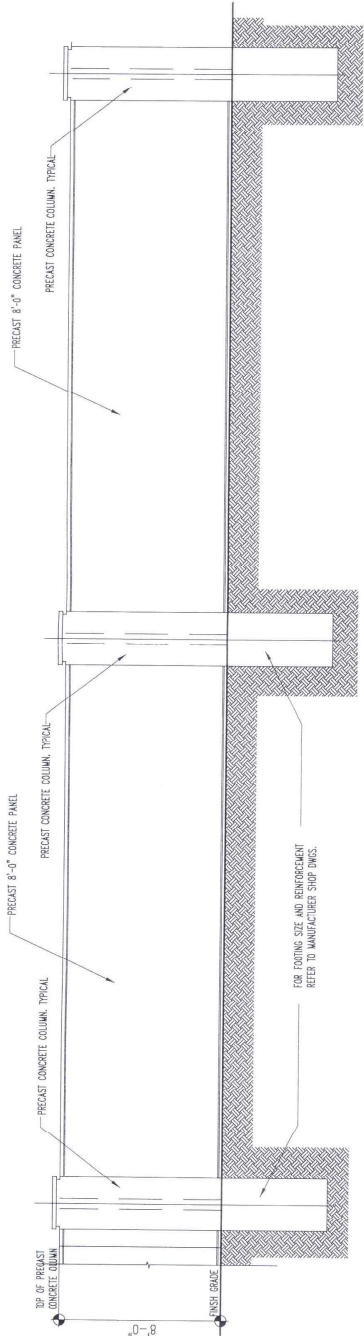

TYPICAL WALL ELEVATION.

SCALE: 1/8" = 1'-0"

NOTE:
1. ALL FENCES WILL WITHSTAND 75 MPH WIND
(FENCE MANUFACTURER SHALL SUBMIT SHOP
DRAWINGS FOR REVIEW AND/OR
APPROVAL BY A LICENSED PROFESSIONAL
STRUCTURAL ENGINEER FOR APPROVAL PRIOR
TO FABRICATION).

8' HIGH PRECAST WALL DETAIL
TOTAL 6,743.50 LF.
N.T.S.


CONCRETE NOTES:

1. ALL POURED IN PLACE CONCRETE 3,000 PSI
28 DAYS MIN.
2. ALL CONCRETE WORK IN ACCORDANCE WITH THE
BUILDING CODE REQUIREMENTS FOR STRUCTURAL
CONCRETE (ACI 318-05).
3. ADMIXTURES ARE NOT PERMITTED WITHOUT WRITTEN
APPROVAL OF ENGINEER.

SOIL STATEMENT:

AS PER VISUAL INSPECTION SOIL CONDITIONS AT THIS
SITE ARE SAND AND ROCK WITH A MINIMUM BEARING
CAPACITY OF 2,000 P.S.F.

Exhibit "B"

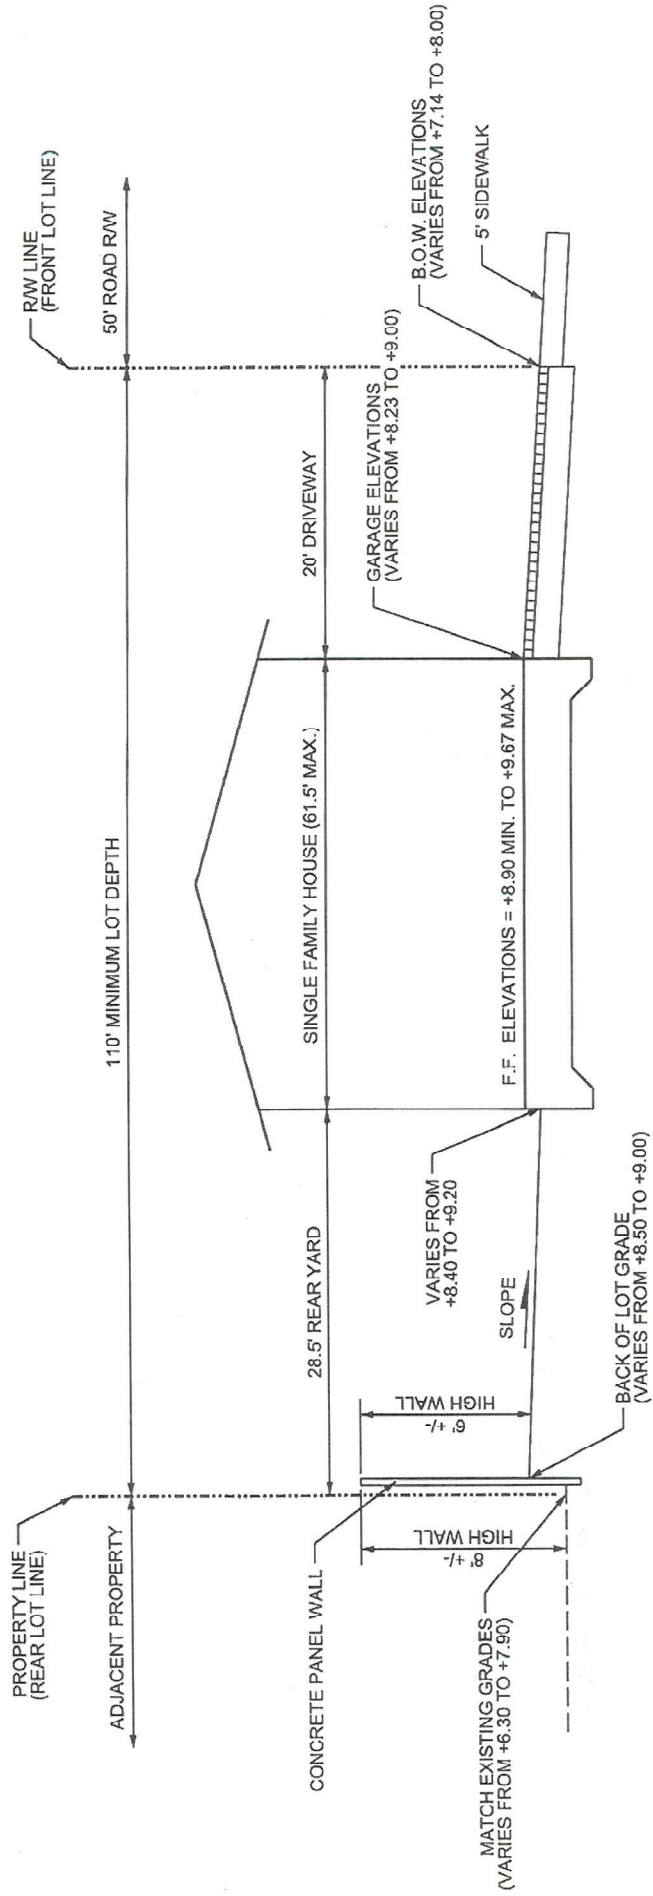

TYPICAL LOT SECTION (OPTION C)

@ NORTH PROPERTY LINE

N.T.S.